


Estimation of Standpipe Fill Time - Based on Compressor Size in HP (Boston - 4 Hours Max.)

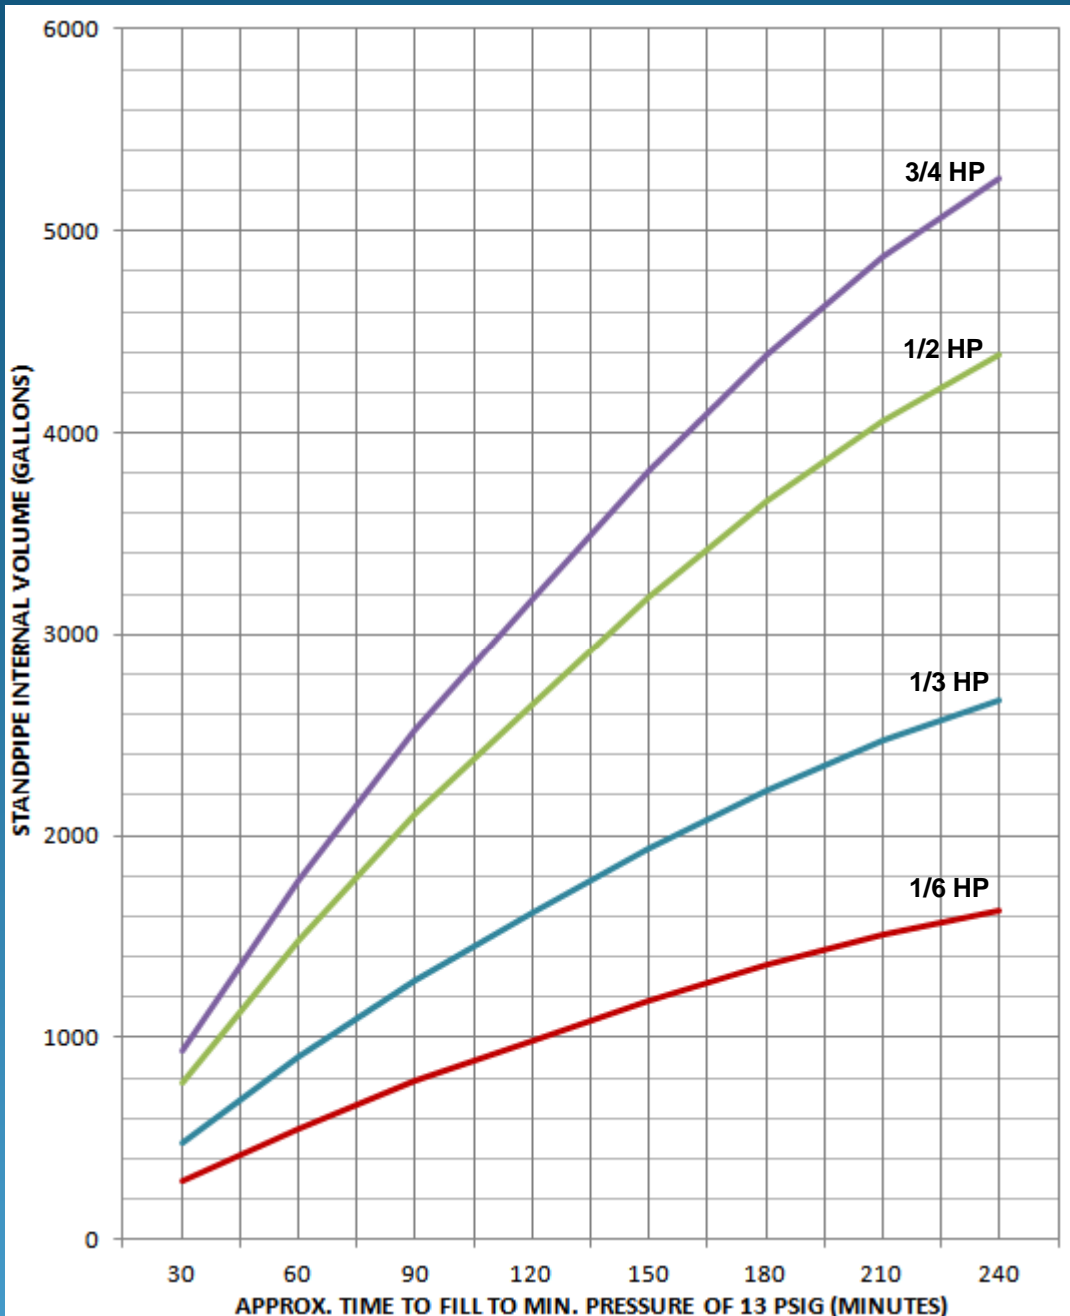

Fill time is important for estimating downtime when standpipe is added to or sections are removed. A quicker fill time allows the standpipe to be returned to service sooner. Boston FD TCM3-51725 mandates ceasing all construction or demolition operations if the standpipe is not restored within 4 hours of impairment. Choose compressor size accordingly.

UNITED Fire Systems

Division of UNITED Fire Protection Corporation

1 Mark Road

Kenilworth, NJ USA 07033

908-688-0300



www.unitedfiresystems.net