



Data Sheet UFS-110B
Rev 4.03 Page 1 of 2



PREACTION-PAC GENERATION 2 WITH INTEGRATED NITROGEN

FEATURES

- **FM Approved**
- **NYC FD Certificate of Approval #6148**
- **CSFM Listing No. 7080-2143:0100**
- Includes preaction valve with optional control panel and integral, self-contained nitrogen-based corrosion inhibiting system
- Industry exclusive - preaction and nitrogen generator assemblies designed and built by the same manufacturer
- Fully factory assembled, programmed, and tested
- No field assembly required
- Just connect water supply, drain, sprinkler piping, power, and electrical devices

BENEFITS

- Saves assembly, programming, and installation time
- Installation drawings available
- Quicker commissioning – just place, connect, and it's ready
- Easy inspection and maintenance
- Expert in-house field and technical support

DESCRIPTION

The **FM Approved UNITED Fire Systems PREACTION-PAC™ with Integrated Nitrogen** is a fully assembled preaction fire suppression system, including preaction valve, trim, nitrogen generator, and optional control panel, providing one complete zone of preaction water sprinkler fire protection. All components are contained in three (3) red powder-coated steel enclosures. Preaction and nitrogen system indicators and controls are mounted facing forward for easy reference and use. The system detection and control panel is mounted behind a door on the electrical enclosure with a clear polycarbonate window allowing examination of the detection system visual indicators. Lockable latches on enclosure doors permit restricted access to connections and components. A manual release valve is located behind a non-locking door on the valve enclosure. Gasketing provides sealing of the enclosure doors. Knockouts permit easy attachment of external electrical raceways.

Preaction Valve

The preaction valve assembled in the **PREACTION-PAC** is a low-differential, latched clapper valve using a unique direct acting diaphragm to separate the system water supply from the system piping. The positive latching system uses the supply water pressure to hold the clapper shut. When the water pressure in the diaphragm chamber is released, the latch retracts from the clapper and the valve opens. The low differential and unique latch and actuator design allows the valve to be self-resetting.

Valve Interlock Designated As "P1"

PREACTION-PAC™ assemblies with "P1" in the part number designation (refer to Ordering Information) may be field-configured to operate in *either* of two (2) ways:

- **Single Interlock:** The preaction valve opens upon actuation of a fire detector connected to the system control panel, allowing water into the sprinkler pipe.
- **Double Interlock Electric / Electric:** The preaction valve opens upon actuation of a fire detector connected to the system control panel AND when the system control panel receives a low air signal from the supervisory switch attached to the valve trim (due to an open sprinkler head). [NOTE – Operation of the low air switch without actuation of a fire detector results in a low air supervisory signal and does not open the preaction valve.]

For additional information, refer to **UNITED Fire Systems** Technical Note [UFS-24-02](#).

- Space for required spare sprinkler heads and wrench
 - Attractive, rugged, powder-coated metal enclosures
 - Separate, lockable mechanical, electrical, and nitrogen enclosures
 - Manual actuation valve behind separate non-locking door
 - Easy-to-see indicators and gauges face the front
 - Easy-to-follow instructions on control panel enclosure front
 - Membrane-based nitrogen generation - no moving parts
 - Long-life, low maintenance oilless air compressor
 - 1-1/2 through 6 inch valve options
 - Addressable control panel options
- Finished appearance allows placement in or near protected space
 - Rapid access to manual release handle without a key
 - Reliable, dependable protection that functions as designed
 - Reliable, long-lasting nitrogen generation



UNITED Fire Systems

Division of United Fire Protection Corporation
1 MARK ROAD
KENILWORTH, NJ 07033 USA
PHONE: 908-688-0300
unitedfiresystems.com

This literature is provided for informational purposes only. **UNITED Fire Systems** assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as intended. The information in this document is believed to be correct at the time of publication. **UNITED Fire Systems** reserves the right to add to, delete, or revise any information in this document without notice.



APPROVED
Data Sheet UFS-110B
Rev 4.03 Page 2 of 2



Valve Interlock Designated As "P2"

PREACTION-PAC™ assemblies with "P2" in the part number designation (refer to Ordering Information) are factory-configured to operate as Double Interlock Pneumatic / Electric. Open sprinkler head actuation is sensed by a pneumatic actuator connected to the valve trim. This is a different device from the low air supervisory switch.

Piping

Water inlet and drain connections are located on the lower right side of the valve enclosure. The outlet connection is on the top surface of the valve enclosure, behind the electrical enclosure. Grooved pipe is used for the inlet and outlet connections.


Detection & Control Panel

Optional control panels allow for a choice between three different brands of fully programmable and networkable addressable systems. All necessary internal wiring connections are factory-assembled and tested.

Nitrogen Generator

The integral, self-contained UNITED Fire Systems NITROGEN-PAC™ corrosion inhibiting system contains an air compressor, filters, and a membrane device to perform nitrogen separation. The system provides dry air for system initial fill and nitrogen for filling the interior of the preaction sprinkler system with nitrogen at 98% or greater purity. The riser-mounted receiver provides a reservoir of nitrogen, reducing the number of compressor starts and the total compressor run time. For additional information, refer to UNITED Fire Systems data sheet UFS-600C and manual 30-NPWCIM-000.

Ordering Information

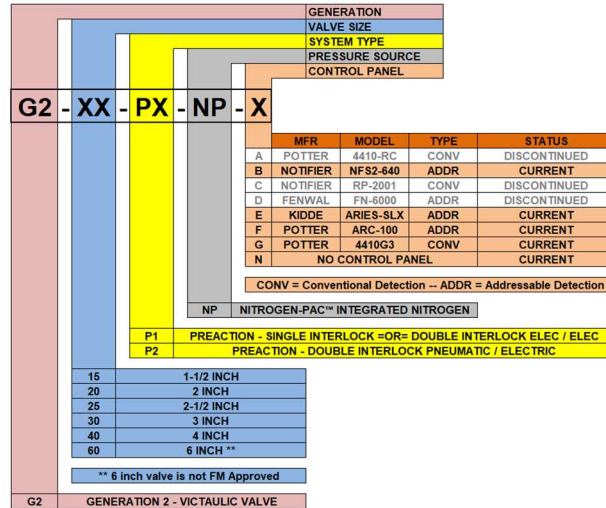

Options (refer to Ordering Information)

- Choice of preaction valve size and type
- Choice of control panel (3 addressable panels available)

Wiring

Power for the control panel and for the nitrogen generator is brought to a terminal strip located in the electrical enclosure. Terminal are provided to connect two (2) separate 115 VAC 60 Hz single-phase circuits. No access to the inside of the valve enclosure or the nitrogen generator enclosure is necessary to complete the wiring installation. All necessary internal wiring for waterflow, tamper, and supervisory switches, plus solenoid activation, is factory-installed and tested.

Dimension	With Built-In Control Panel	Without Built-In Control Panel
A - Depth	24	24
B - Mechanical Enclosure	52	52
C - Electrical Enclosure	20	10
D - Width	40	40
E - Height	72	72

NOTE: All dimensions are in inches.

Table A - Dimensions


Specifications

- Maximum Service Pressure: 300 PSIG (2065 kPa gauge)
- Valve Test Pressure: Factory hydrostatically tested to 600 PSIG (4135 kPa gauge)
- Minimum Supervisory Pressure: 13 PSIG (90 kPa gauge)
- Maximum Supervisory Pressure: 18 PSIG (124 kPa gauge)
- Electrical and Nitrogen Generator Enclosures: 14 gauge steel with continuous welded seams
- Mechanical Enclosure: 12 gauge steel with continuous welded seams

Dimensions – Refer to Table A

With Control Panel

Without Control Panel

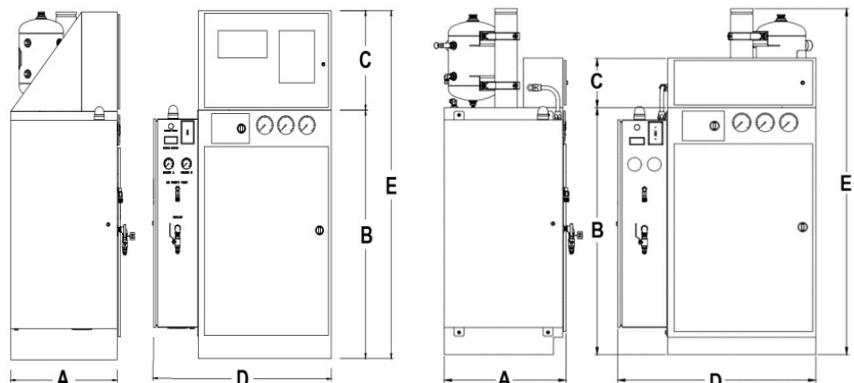

- PREACTION-PAC™ Access Doors: Full hinge with oil-resistant gaskets
 - NITROGEN-PAC Access Door: Lift-off hinge pins for easy door removal
 - External Power Requirement: Qty. (2) 115 VAC, 60 Hz, single-phase circuits
 - Maximum Sprinkler System Volume: **500 gallons** for initial-fill in 30 minutes or less with air per NFPA 13
- Maximum volume value based on sprinkler-pipe leakage not exceeding 1-1/2 PSIG air pressure loss in 24 hours starting at 40 PSIG per NFPA 13 requirement

UNITED Fire Systems

Division of United Fire Protection Corporation
1 MARK ROAD
KENILWORTH, NJ 07033 USA
PHONE: 908-688-0300
unitedfiresystems.com

This literature is provided for informational purposes only. UNITED Fire Systems assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as intended. The information in this document is believed to be correct at the time of publication. UNITED Fire Systems reserves the right to add to, delete, or revise any information in this document without notice.