
SPRINKLER-PAC GENERATION 2 – DRY-PIPE VALVE

FEATURES

- **Compressor (where used) UL Certified to UL Standard 1450**
- Fully factory assembled and tested
- No field assembly required
- Just connect water supply, drain, and sprinkler piping
- Attractive and rugged metal enclosure
- Easy-to-see gauges on enclosure front
- Separate, lockable mechanical and electrical enclosures
- Space for required spare sprinkler heads and wrench
- UL / FM / NYC approved major components
- 1-1/2 through 6 inch valve options

BENEFITS

- Saves assembly and installation time
- Quicker commissioning – just place, connect, and it's ready
- Finished appearance allows placement in or near protected space
- Reliable, dependable protection that functions as designed
- Easy inspection and maintenance
- Expert in-house and field technical support

DESCRIPTION

The **UNITED Fire Systems SPRINKLER-PAC** is a fully assembled dry-pipe sprinkler valve fire suppression system, including dry-pipe valve and trim, providing one complete zone of dry-pipe water sprinkler fire protection. All components are contained in two (2) powder-coated steel enclosures assembled one above the other. The system pressure gauges are mounted on the front of the mechanical enclosure. The connections allowing monitoring of waterflow, tamper, and low / high air signaling switches are behind the electrical enclosure door. Lockable latches on both doors permit restricted access to connections and components. Gasketing provides sealing of the enclosure doors. Knockouts permit easy attachment of external electrical raceways.

Dry-Pipe Valve

The dry-pipe valve assembled in the Dry-Pipe Valve **SPRINKLER-PAC** is a low-differential, latched clapper valve that uses a unique direct-acting diaphragm to separate the system water supply from the system piping. The positive latching system uses the supply water pressure to hold the clapper shut. When the water pressure in the diaphragm chamber is released, the latch retracts from the clapper and the valve actuates. The low differential and unique latch and actuator design of the valve allows the valve to be self-resetting.

Piping

Water inlet and drain connections are located on the lower left and right side of the mechanical enclosure. The outlet connection is on the top surface of the mechanical enclosure, behind the electrical enclosure. Grooved pipe is used for the inlet and outlet connections.

Wiring

Monitoring and supervisory circuits are connected from switches in the valve enclosure to a terminal strip in the electrical enclosure. No access to the inside of the valve enclosure is necessary to complete the wiring installation.

**UNITED Fire Systems**

Division of United Fire Protection Corporation
 1 MARK ROAD
 KENILWORTH, NJ 07033 USA
 PHONE: 908-688-0300
unitedfiresystems.com

This literature is provided for informational purposes only. UNITED Fire Systems assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as intended. The information in this document is believed to be correct at the time of publication. UNITED Fire Systems reserves the right to add to, delete, or revise any information in this document without notice.



Options

- Choice of dry-pipe valve size (1-1/2 inch through 6 inch available)
- Choice of compressor size - Refer to **Table B**
- Installed Model NAMD-1 pressure maintenance device, making the assembly ready for external supervisory pressure source
- Integrated nitrogen-based corrosion-inhibiting system (refer to Data Sheet **UFS-110H**)

Specifications

- Maximum Service Pressure: 300 PSIG (2065 kPa gauge)
- Valve Test Pressure: Factory hydrostatically tested to 600 PSIG (4135 kPa gauge)
- Minimum Supervisory Pressure: 13 PSIG (90 kPa gauge)
- Maximum Supervisory Pressure: 18 PSIG (124 kPa gauge)
- Electrical Enclosure: 14 gauge steel with continuous welded seams
- Mechanical Enclosure: 12 gauge steel with continuous welded seams
- Access Doors: Full hinge with oil-resistant gaskets

Ordering Information

		GENERATION	
		VALVE SIZE	
		SYSTEM TYPE	
		PRESSURE SOURCE	
		CONTROL PANEL	
G2	- XX	- D1	- X - N
		N NO CONTROL PANEL	
		1 1/6 HP COMPRESSOR	
		2 1/3 HP COMPRESSOR	
		3 1/2 HP COMPRESSOR	
		N NITROGEN-READY WITH MODEL NAMD-1	
		D1	DRY-PIPE
		15	1-1/2 INCH
		20	2 INCH
		25	2-1/2 INCH
		30	3 INCH
		40	4 INCH
		60	6 INCH
G2	GENERATION 2 - VICTAULIC VALVE		


Dimensions - Refer to Table A

Dimension	Length
A - Depth	24
B - Valve Enclosure	52
C - Electrical Enclosure	10
D - Width	30
E - Height	64
NOTE: All dimensions are in inches	

Table A - Dimensions

Compressor HP	Maximum Sprinkler Pipe Volume Gallons
1/6	220
1/3	430
1/2	670
Maximum sprinkler pipe volume is for initial-fill to 18 PSIG in 30 minutes to satisfy NFPA 13	

Table B - Built-In Compressor Capacity

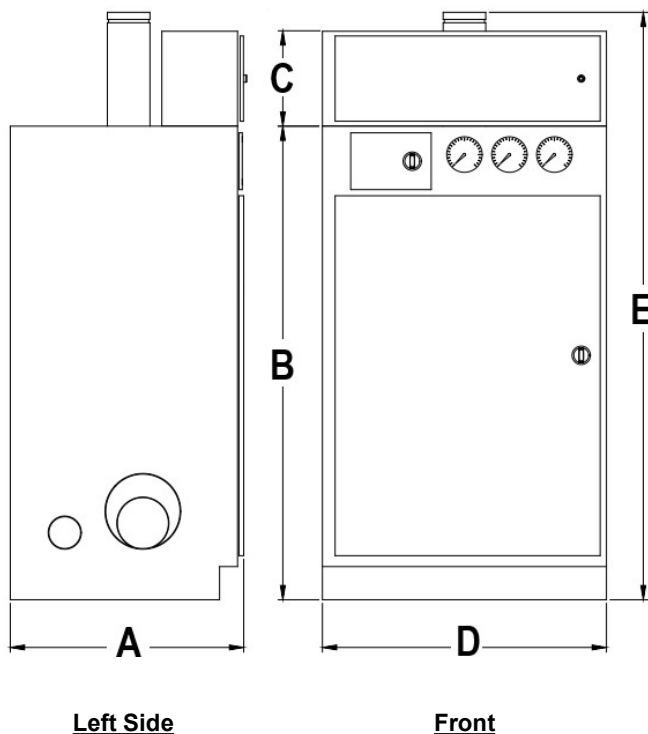

UNITED Fire Systems

Division of United Fire Protection Corporation
1 MARK ROAD
KENILWORTH, NJ 07033 USA
PHONE: 908-688-0300
unitedfiresystems.com

This literature is provided for informational purposes only. UNITED Fire Systems assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as intended. The information in this document is believed to be correct at the time of publication. UNITED Fire Systems reserves the right to add to, delete, or revise any information in this document without notice.